



Designated according to The Construction Products (Amendment etc.) (EU Exit) Regulations 2020

UK Technical Assessment	UKTA-0836-22/6346 of 07/11/2022
Technical Assessment Body issuing the UK Technical Assessment:	British Board of Agrément
Trade name of the construction product:	R-LX
Product family to which the construction product belongs:	Area Code 33, Concrete screw for multiple use for non-structural applications in concrete
Manufacturer:	RAWLPLUG S.A. ul. Kwidzyńska 6 51-416 Wrocław Poland
Manufacturing plant(s):	Manufacturing Plant No. 2
This UK Technical Assessment contains:	18 pages including 3 annexes which form an integral part of this assessment
This UK Technical Assessment is issued in accordance with The Construction Products (Amendment etc.) (EU Exit) Regulations 2020 on the basis of:	UKAD 330747-00-0601 <i>Fasteners for use in concrete for redundant non-structural systems</i>

Communication of this UK Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made with the written consent of the British Board of Agrément. Any partial reproduction must be identified as such.

1 Technical description of the product

The R-LX are concrete screw anchors. The anchors are manufactured from zinc plated (ZP) or zinc flaked (ZF) steel.

The anchor is screwed into a predrilled cylindrical hole. The special thread of the anchor cuts an internal thread into the concrete member while setting. The anchorage is characterised by mechanical interlock in the special thread.

The description of the product is given in Annex A.

2 Specification of the intended use(s) in accordance with the applicable UK Assessment Document (hereinafter UKAD)

The performances given in Section 3 are only valid if the anchors are used in compliance with the specifications and conditions given in Annex B.

The performances given in this UK Technical Assessment are based on an assumed working life of the product of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer or the Technical Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance in concrete	See Annex C1 and C2
Edge distances and spacing	See Annex C1 and C2

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchors satisfy requirements for Class A1
Resistance to fire	See Annex C3

3.3 Health, hygiene and the environment (BWR 3)

Not relevant.

3.4 Safety and accessibility in use (BWR 4)

Not relevant.

3.5 Protection against noise (BWR 5)

Not relevant.

3.6 Energy economy and heat retention (BWR 6)

Not relevant.

3.7 Sustainable use of natural resources (BWR 7)

No performance assessed.

3.8 Methods used for assessment

The assessment of the products has been made in accordance with UKAD 330747-00-0601.

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied

4.1 System of assessment and verification of constancy of performance

According to UKAD No. 330747-00-0601 and Annex V of the Construction Products Regulation (Regulation (EU) 305/2011 as brought into UK law and amended, the system of assessment and verification of constancy of performance (AVCP) 2+ applies.

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable UKAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with the British Board of Agrément and made available to the UK Approved Bodies involved in the conformity attestation process.

5.1 UKCA marking for the product/ system must contain the following information:

- Identification number of the Approved Body
- Name/address of the manufacturer of the product/ system
- Marking with intention of clarification of intended use
- Date of marking
- Number of certificate of constancy of performance
- UKTA number.





On behalf of the British Board of Agrément	
	
Date of Issue: 7 November 2022	Hardy Giesler Chief Executive Officer



British Board of Agrément,
1st Floor Building 3
Hatters Lane
Croxley Park
Watford
WD18 8YG

ANNEXES





This annex applies to the product described in the main body of the UK Technical Assessment.
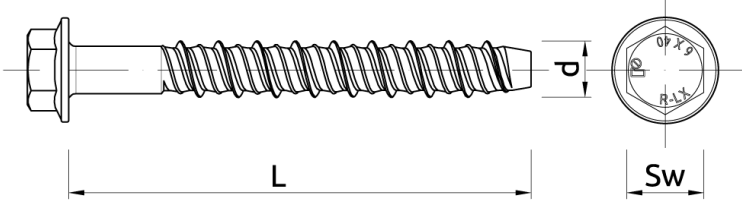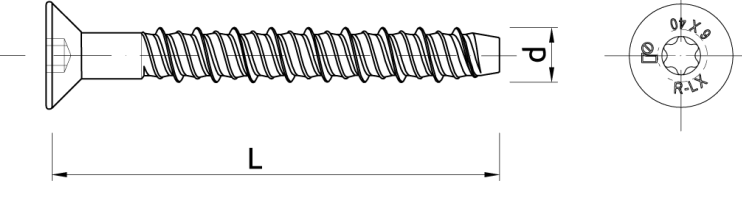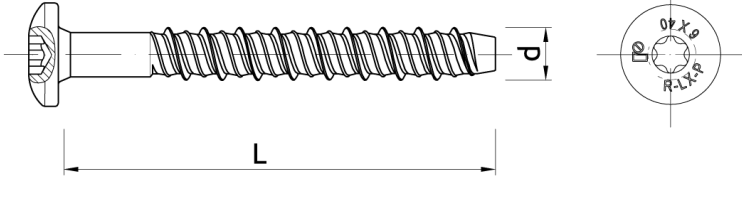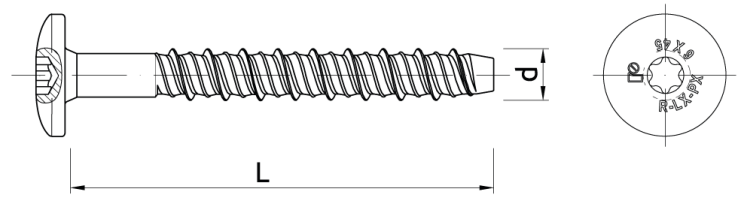
<p>R-LX-HF</p>	
<p>R-LX-CS</p>	
<p>R-LX-P</p>	
<p>R-LX-PX</p>	

R-LX

Product description
 Characteristics of the product

Annex A 1

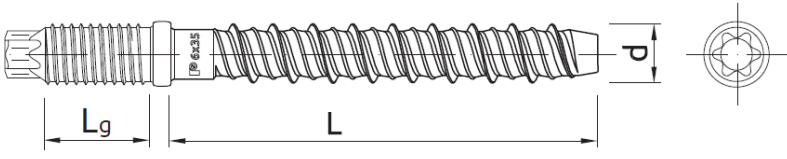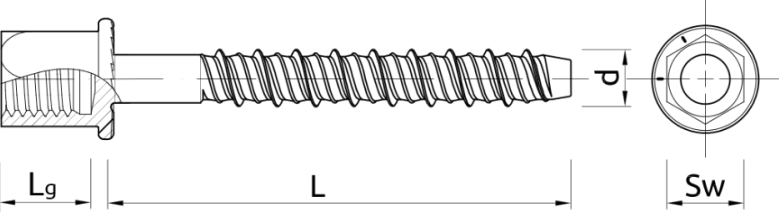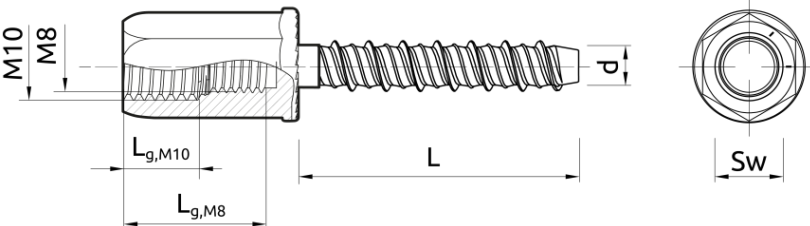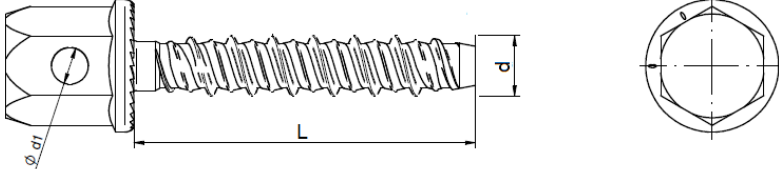R-LX-E	
R-LX-I	
	
R-LX-W	


R-LX

Product description
 Characteristics of the product

Annex A 2

Table A1: Dimensions and material for R-LX-HF, R-LX-CS, R-LX-P and R-LX-PX

Anchor size			R-LX-05	R-LX-06	R-LX-08	R-LX-10	R-LX-14
Thread size	d	mm	6.2	7.5	9.9	12.4	17.4
Length of anchor	L	mm	30 - 250	35 - 250	55 - 250	60 - 250	80 - 250
Nominal hole diameter	d ₀	mm	5	6	8	10	14
Tip chamfer	h _s	mm	2.5	3	4	4.5	6
Pitch	h _t	mm	4.2	5	6.7	8.3	11.6
Material: Carbon steel	f _{uk}	N.mm ⁻²	1300	1250	1200	1050	1020
	f _{yk}	N.mm ⁻²	1150	1100	1050	950	800
Coating	Zinc Plated (ZP ≥ 5 μm) or Zinc Flaked (ZF ≥ 5 μm)						

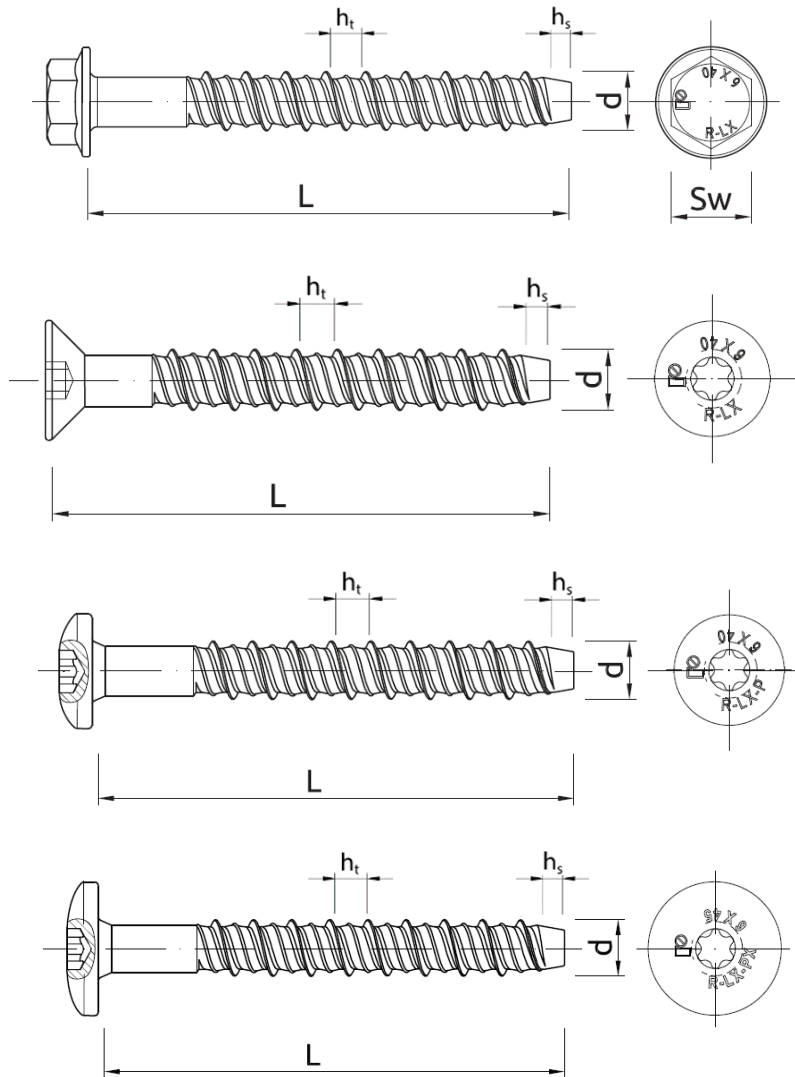


R-LX

Product description
Dimensions and material

Annex A 3

Table A2: Dimensions and material for R-LX-I, R-LX-E and R-LX-W

Anchor size			R-LX-05	R-LX-06	R-LX-08	R-LX-10
Thread size	d	mm	6.2	7.5	9.9	12.4
Length of anchor R-LX-E	L	mm	-	35 - 240	50 - 240	55 - 240
Length of anchor R-LX-I	L		25 - 240	35 - 240	50 - 240	55 - 240
Nominal hole diameter	d ₀	mm	5	6	8	10
Tip chamfer	h _s	mm	2.5	3	4	4.5
Pitch	h _t	mm	4.2	5	6.7	8.3
Minimum thread length	L _g ≥	mm	8	8	8	8
External thread (R-LX-E)	-	-	-	M8	M10	M12
Internal thread (R-LX-I)	-	-	M6	M6, M8, M10, M8/M10	M12	M12, M16
Dimension of hole in head (R-LX-W)	d ₁	mm	-	5.5	6.5	7.5
Material: Carbon steel	f _{uk}	N/mm ²	1300	1250	1200	1050
	f _{yk}	N/mm ²	1150	1100	1050	950
Coating	Zinc Plated (ZP ≥ 5 μm) or Zinc Flaked (ZF ≥ 5 μm)					

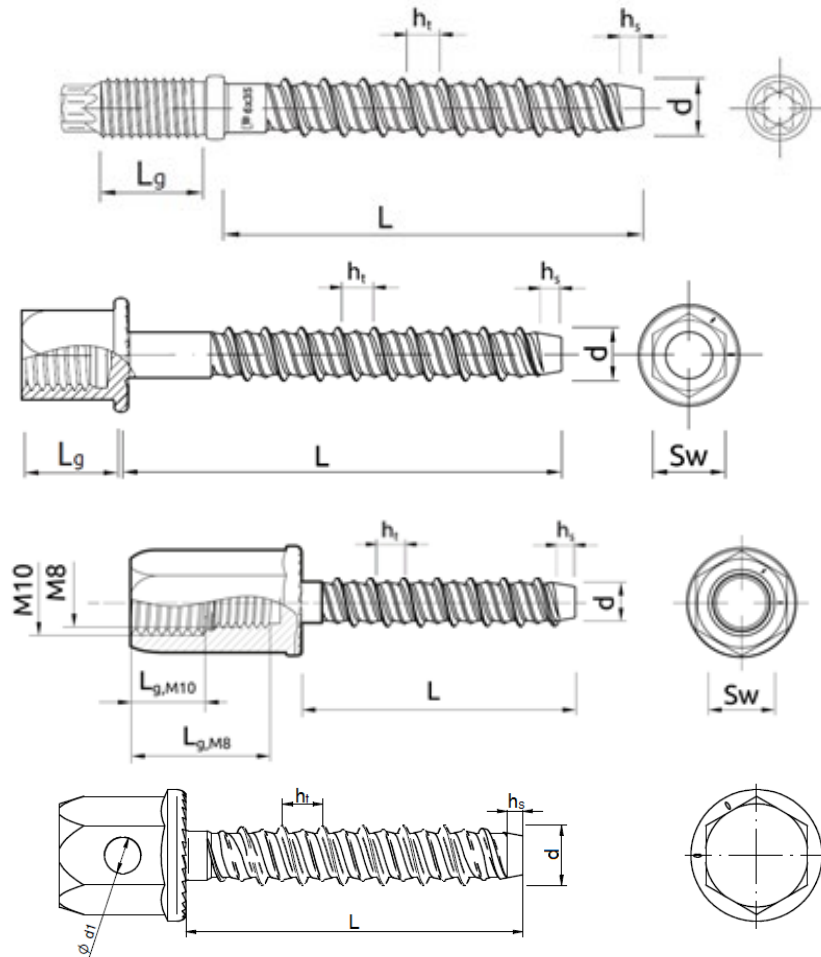

R-LX

Product description
Dimensions and material

Annex A 4

Specification of intended use

Anchorage subject to:

- Multiple use for non-structural applications.
- Static and quasi-static loads.
- Anchorages with requirements related to resistance to fire – only for normal weight concrete.

Base material:

- Reinforced or unreinforced normal weight concrete of strength class C20/25 at minimum to C50/60 at maximum according to EN 206.
- Non-cracked and cracked concrete: all sizes.
- Precast prestressed hollow concrete slabs (with $w/e \leq 4,2$) and strength class C30/37 at minimum to C50/60 at maximum according to EN 206: size R-LX-06 only.

Use conditions (environmental conditions):

- Structures subject to dry internal conditions.

Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be transmitted. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages under static and quasi-static loads and under fire exposure are designed in accordance with EN 1992-4:2018.


Installation:

- Rotary percussive machine drilling only.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Anchor installation in accordance with the manufacturer's specifications and drawings and using the appropriate tools.
- Check of concrete being well compacted, e.g. without significant voids.
- Positioning of the drill holes without damaging the reinforcement.
- Anchor installation such that the effective anchorage depth is complied with.
- After installation further turning of the anchor is not possible.
- The head of the anchor is supported on the fixture and is not damaged.

R-LX

Intended use
Specification

Annex B 1

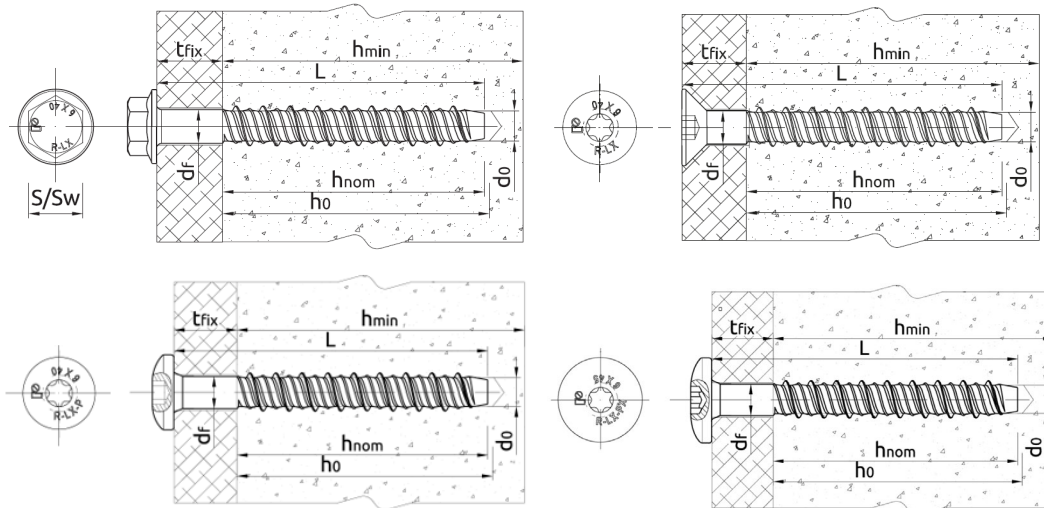

Installed anchor R-LX-HF, R-LX-CS, R-LX-P and R-LX-PX

Table B1: Installation parameters – standard embedment depth

Anchor size			R-LX-05	R-LX-06	R-LX-08	R-LX-10	R-LX-14	
Nominal drill bit diameter	d_0	mm	5	6	8	10	14	
Cutting diameter of drill bit	$d_{cut} \leq$	mm	5.40	6.40	8.45	10.45	14.50	
Depth of drill hole*	$h_0 \geq$	mm	50	65	80	95	130	
Nominal embedment depth	h_{nom}	mm	40	55	70	85	120	
Effective embedment depth	h_{ef}	mm	30	42	53	65	92	
Clearance hole in the fixture	d_f	mm	7	9	12	14	18	
Maximum installation torque	$T_{imp,max}$	Nm	200	400	900	950	950	
Minimum thickness of member	h_{min}	mm	80	84	110	130	190	
Thickness of the fixture, max.	t_{fix}	mm	$L - h_{nom}$					

* Real depth of drill hole $h_0 = L + 10 - t_{fix}$

Table B2: Installation parameters – reduced embedment depth


Anchor size			R-LX-05	R-LX-06	R-LX-08	R-LX-10	R-LX-14	
Nominal drill bit diameter	d_0	mm	5	6	6	8	10	
Cutting diameter of drill bit	$d_{cut} \leq$	mm	5.40	6.40	6.40	8.45	10.45	
Depth of drill hole*	$h_0 \geq$	mm	35	45	50	60	65	
Nominal embedment depth	h_{nom}	mm	25	35	39	50	55	
Effective embedment depth	h_{ef}	mm	17.5	24.7	30	37	40	
Clearance hole in the fixture	d_f	mm	7	9	9	12	14	
Maximum installation torque	$T_{imp,max}$	Nm	200	400	400	900	950	
Minimum thickness of member	h_{min}	mm	80	80	80	80	110	
Thickness of the fixture, max.	t_{fix}	mm	$L - h_{nom}$					

* Real depth of drill hole $h_0 = L + 10 - t_{fix}$

R-LX

Intended use
Installation parameters – concrete

Annex B 2

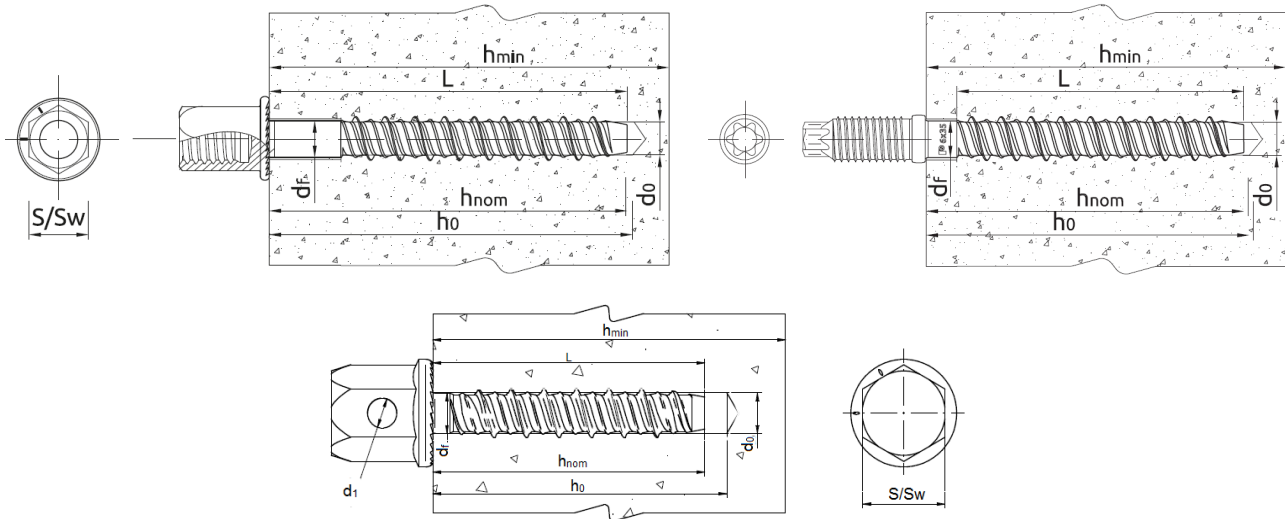

Installed anchor R-LX-I, R-LX-E and R-LX-W

Table B3: Installation parameters – standard embedment depth

Anchor size		R-LX-05	R-LX-06	R-LX-08	R-LX-10	
Nominal drill bit diameter	d_0	mm	5	6	8	10
Cutting diameter of drill bit	$d_{cut} \leq$	mm	5.40	6.40	8.45	10.45
Depth of drill hole*	$h_0 \geq$	mm	50	65	80	95
Nominal embedment depth	h_{nom}	mm	40	55	70	85
Effective embedment depth	h_{ef}	mm	30	42	53	65
Maximum installation torque	$T_{imp,max}$	Nm	200	400	900	950
Minimum thickness of member	h_{min}	mm	80	84	110	130

* Real depth of drill hole $h_0 = L + 10 - t_{fix}$

Table B4: Installation parameters – reduced embedment depth

Anchor size		R-LX-05	R-LX-06	R-LX-08	R-LX-10		
Nominal drill bit diameter	d_0	mm	5	6	6	8	10
Cutting diameter of drill bit	$d_{cut} \leq$	mm	5.40	6.40	6.40	8.45	10.45
Depth of drill hole*	$h_0 \geq$	mm	35	45	50	60	65
Nominal embedment depth	h_{nom}	mm	25	35	39	50	55
Effective embedment depth	h_{ef}	mm	17.5	24.7	30	37	40
Maximum installation torque	$T_{imp,max}$	Nm	200	400	400	900	950
Minimum thickness of member	h_{min}	mm	80	80	80	80	80

* Real depth of drill hole $h_0 = L + 10 - t_{fix}$


Table B5: Minimum spacing and edge distance

Anchor size		R-LX-05	R-LX-06	R-LX-08	R-LX-10	R-LX-14	
Minimum edge distance	c_{min}	mm	40	45	50	60	100
Minimum spacing	s_{min}	mm	40	45	50	60	100

R-LX

Intended use
Installation parameters – concrete

Annex B 3

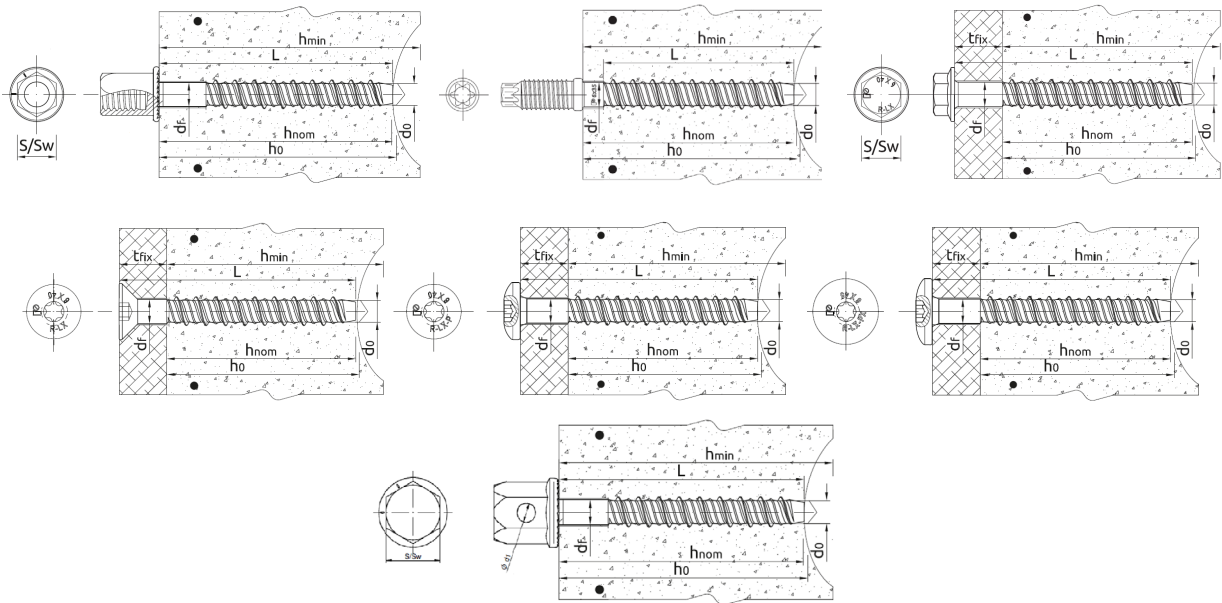


Installed anchor R-LX-I, R-LX-E, R-LX-HF, R-LX-CS, R-LX-P, R-LX-PX and R-LX-W (hollow concrete slabs)

Table B6: Installation parameters

Anchor size			R-LX-06
Nominal drill bit diameter	d_0	mm	6
Cutting diameter of drill bit	$d_{cut} \leq$	mm	6.40
Depth of drill hole*	$h_0 \geq$	mm	45
Nominal embedment depth	h_{nom}	mm	35
Effective embedment depth	h_{ef}	mm	24.7
Maximum installation torque	$T_{imp,max}$	Nm	400
Minimum edge distance	c_{min}	mm	50
Minimum spacing	s_{min}	mm	100
Minimum distance between anchor groups	a_{min}	mm	100

* Real depth of drill hole $h_0 = L + 10 - t_{fix}$

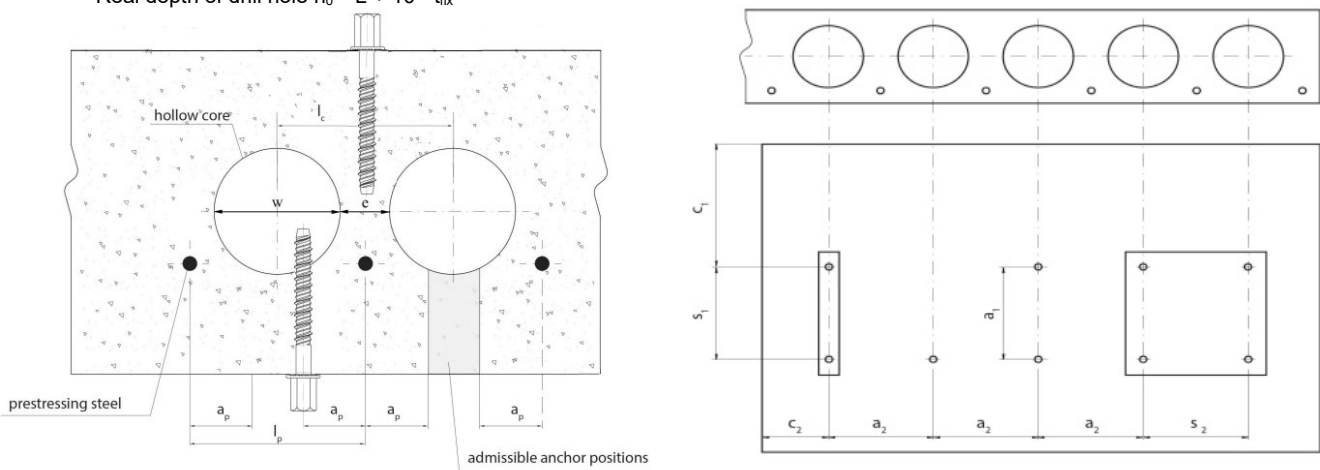


1. Core width / Web thickness	2. ≤ 4.2
3. Core distance	4. $l_c \geq 100$ mm
5. Prestressing steel	6. $l_p \geq 100$ mm
7. Distance between anchor position and prestressing steel	8. $a_p \geq 50$ mm

c_1, c_2 - edge distance
 s_1, s_2 - anchor spacing
 a_1, a_2 - distance between anchor groups


R-LX

Intended use
 Installation parameters – hollow concrete slabs


Annex B 4

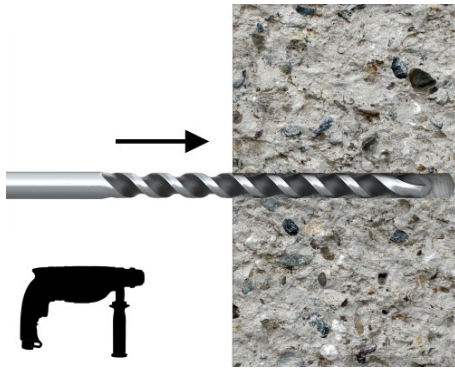


Drill the hole with rotary hammer drilling machine. Drill to a required depth.

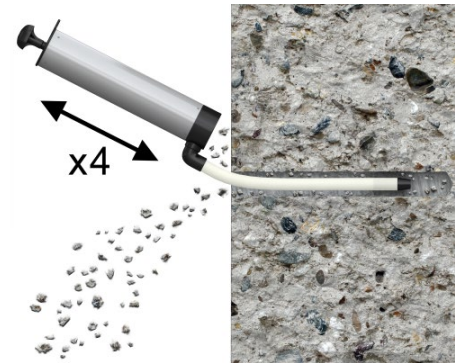

Clean the drill hole (blow out dust at least 4 times with a hand pump).

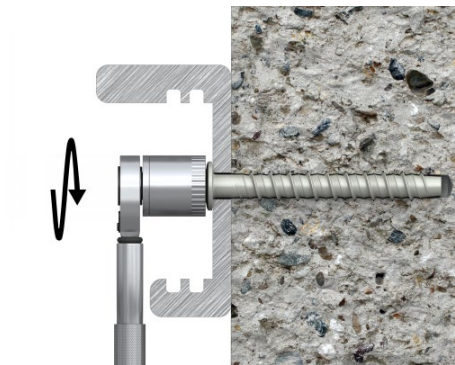

Tighten the anchor to the substrate. Installation with any torque impact screwdriver up to the maximum torque moment ($T_{imp,max}$).

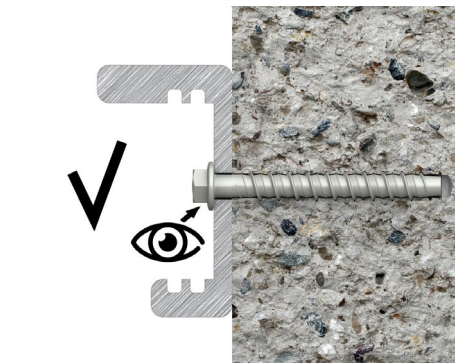

After installation a further turning of the screw must not be possible. The head of the screw must be in contact with the fixture / substrate and is not damaged.

R-LX

Intended use
Installation instruction and tools – concrete

Annex B 5



Drill the hole with rotary hammer drilling machine. Drill to a required depth.



Clean the drill hole (blow out dust at least 4 times with a hand pump).

Cleaning of drill hole is not necessary in case of:

- drilling vertically upwards or
- drilling vertically downwards and the drill hole depth has been increased. It is recommended to increase the drill hole depth with additional $3 \times d_0$.



Tighten the anchor to the substrate.

Installation with any torque impact screwdriver up to the maximum torque moment ($T_{imp,max}$).



Install the fastening element.



After installation a further turning of the screw must not be possible. The head of the screw must be in contact with the fixture / substrate and is not damaged.



R-LX

Intended use
Installation instruction and tools – hollow concrete slabs

Annex B 6

Table C1: Characteristic values in concrete – standard embedment depth

Anchor			R-LX				
Size			R-LX-05	R-LX-06	R-LX-08	R-LX-10	R-LX-14
Any load directions							
Characteristic resistance in cracked and non-cracked concrete C20/25	F^{0}_{Rk}	[kN]	5	9	12	20	30
Installation safety factor	γ_{inst}	[-]	1.2	1.0			
Increasing factors for F^{0}_{Rk}	ψ_c	C30/37	1.08				
		C40/50	1.15				
		C50/60	1.19				
Effective embedment depth	h_{ef}	[mm]	30	42	53	65	92
Spacing	s_{cr}	[mm]	90	126	160	196	276
Edge distance	c_{cr}	[mm]	45	63	80	98	138
Shear load with lever arm							
Characteristic bending moment	$M^{0}_{Rk,s}$	[Nm]	19.0	31.8	72.4	123.6	329.6
Partial safety factor	$\gamma_{M,s}$	[-]	1.5				

Table C2: Characteristic values in concrete – reduced embedment depth

Anchor			R-LX				
Size			R-LX-05	R-LX-06	R-LX-08	R-LX-10	R-LX-14
Any load directions							
Characteristic resistance in cracked and non-cracked concrete C20/25	F^{0}_{Rk}	[kN]	3	6	7.5	9	12
Installation safety factor	γ_{inst}	[-]	1.2	1.0			
Increasing factors for F^{0}_{Rk}	ψ_c	C30/37	1.08				
		C40/50	1.15				
		C50/60	1.19				
Effective embedment depth	h_{ef}	[mm]	17.5	30	37	40	55
Spacing	s_{cr}	[mm]	70	90	120	120	180
Edge distance	c_{cr}	[mm]	35	45	60	60	90
Shear load with lever arm							
Characteristic bending moment	$M^{0}_{Rk,s}$	[Nm]	19.0	31.8	72.4	123.6	329.6
Partial safety factor	$\gamma_{M,s}$	[-]	1.5				

R-LX

Performances

Characteristic resistance - concrete

Annex C 1

Table C3: Characteristic values in concrete - reduced embedment depth

Anchor size			R-LX-06
Any load directions			
Characteristic resistance in cracked and non-cracked concrete C20/25 to C50/60	F_{Rk}^0	[kN]	3
Installation safety factor	γ_{inst}	[-]	1.0
Effective embedment depth	h_{ef}	[mm]	24.7
Spacing	s_{cr}	[mm]	100
Edge distance	c_{cr}	[mm]	50
Shear load with lever arm			
Characteristic bending moment	$M_{Rk,s}^0$	[Nm]	31.8
Partial safety factor	$\gamma_{M,s}$	[-]	1.5

Table C4: Characteristic values in hollow concrete slabs

Anchor size			R-LX-06
Any load directions			
Bottom flange thickness	d_b	[mm]	≥ 35
Characteristic resistance in hollow concrete slabs C30/37	F_{Rk}	[kN]	5
Characteristic resistance in hollow concrete slabs C40/50 to C50/60	F_{Rk}	[kN]	6
Installation safety factor	γ_{inst}	[-]	1.0
Effective embedment depth	h_{ef}	[mm]	24.7
Spacing	s_{cr}	[mm]	100
Edge distance	c_{cr}	[mm]	50
Shear load with lever arm			
Characteristic bending moment	$M_{Rk,s}^0$	[Nm]	31.8
Partial safety factor	$\gamma_{M,s}$	[-]	1.5

R-LX**Performances**

Characteristic resistance – concrete and hollow concrete slabs

Annex C 2

Table C5: Characteristic resistance under fire exposure in concrete C20/25 to C50/60 – standard embedment depth

Anchor			R-LX				
Size			R-LX-05	R-LX-06	R-LX-08	R-LX-10	R-LX-14
Effective embedment depth	[mm]		30	42	53	65	92
All load directions							
Characteristic resistance $F_{Rk,fi}$ ¹⁾	R30	[kN]	0.20	0.28	0.75	1.57	3.08
	R60	[kN]	0.18	0.25	0.65	1.18	2.31
	R90	[kN]	0.14	0.20	0.50	1.02	2.00
	R120	[kN]	0.10	0.14	0.40	0.79	1.54
Spacing	$s_{cr,fi}$	[mm]	4 x h_{ef}				
Edge distance	$c_{cr,fi}$	[mm]	2 x h_{ef}				
The design method covers anchors with a fire attack from one side only. In case of fire attack from more than one side, the edge distance shall be ≥ 300 mm.							

1) in the absence of other national regulations a partial safety factor $\gamma_{M,fi} = 1.0$ is recommended

Table C6: Characteristic resistance under fire exposure in concrete C20/25 to C50/60 – reduced embedment depth

Anchor			R-LX				
Size			R-LX-05	R-LX-06	R-LX-08	R-LX-10	R-LX-14
Effective embedment depth	[mm]		17.5	30	37	40	55
All load directions							
Characteristic resistance $F_{Rk,fi}$ ¹⁾	R30	[kN]	-	0.28	0.75	1.57	3.00
	R60	[kN]	-	0.25	0.65	1.18	2.31
	R90	[kN]	-	0.20	0.50	1.02	2.00
	R120	[kN]	-	0.14	0.40	0.79	1.54
Spacing	$s_{cr,fi}$	[mm]	4 x h_{ef}				
Edge distance	$c_{cr,fi}$	[mm]	2 x h_{ef}				
The design method covers anchors with a fire attack from one side only. In case of fire attack from more than one side, the edge distance shall be ≥ 300 mm.							

1) in the absence of other national regulations a partial safety factor $\gamma_{M,fi} = 1.0$ is recommended

R-LX

Performances

Characteristic resistance under fire exposure – concrete

Annex C 3



British Board of Agrément,
1st Floor Building 3
Hatters Lane
Croxley Park
Watford
WD18 8YG